





CHULA VISTA FIRE DEPARTMENT

FIRE PREVENTION DIVISION

Fire Hydrant Detail

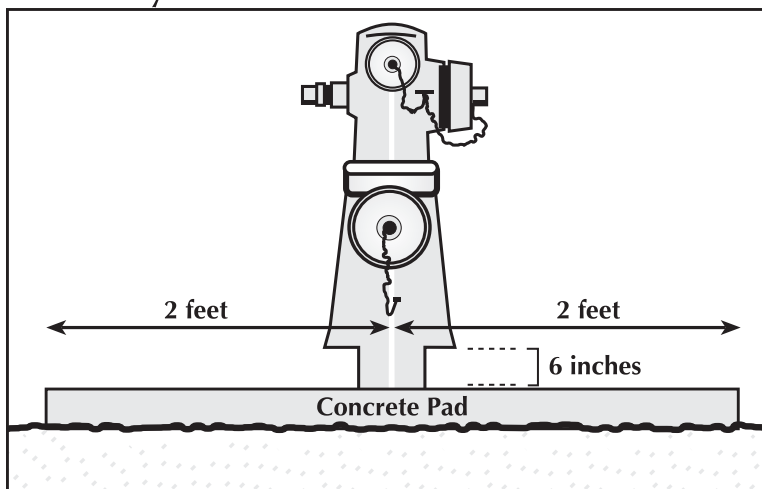

SIDE VIEW

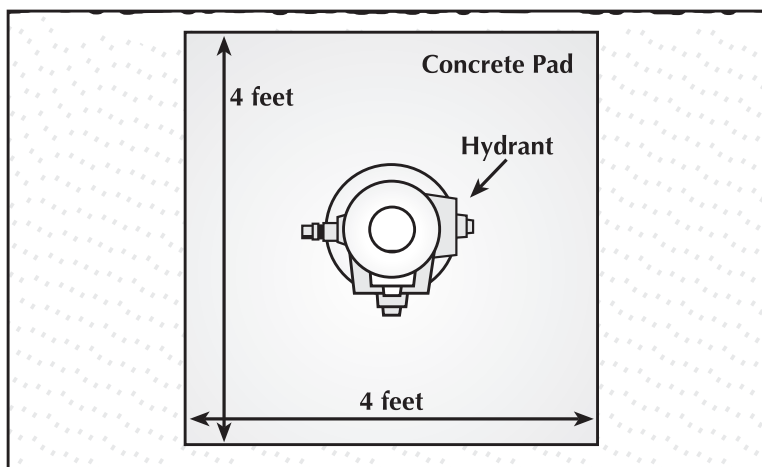

TOP VIEW

Hydrant Specifications

1. Measurements MUST be exact and will be subject to a field inspection
2. Residential and commercial hydrants must have one 4-inch port and two 2 1/2-inch ports with national standard threads (NST)
3. Industrial fire hydrants must have two 4-inch ports and one 2 1/2 inch ports with NST
4. Painted (OSHA) yellow
5. Must have concrete pad adhering to the above specifications
6. A blue reflective marker must be in place to identify fire hydrant location
7. Concrete pad must be a minimum of 4 inches thick
8. Base of hydrant must be 6 inches from concrete pad

